

Appendix C-1 Site Description

The Pattern Barceloneta Solar LLC (the “Project”) is to be constructed on the north side of the island of Puerto Rico just south of county road 2 and directly to the east of the larger adjacent Barceloneta Storage LLC standalone BESS as shown below in *Figure 1*.

Facility Descriptions

The Project’s PV system is rated 60 MW at the POI and is AC-coupled to its lithium-ion battery energy storage system (BESS) which is rated at 31.5 MW / 10.5 MWh (full power discharge at the POI). The POI refers to the meter located on the primary side of the 115 kV GSU Transformer inside the PREPA Barceloneta substation as shown in the SLD in Exhibit B-2 Single Line Diagram. The planned distance from the Project to the substation is approximately 0.05 miles.

Project Site

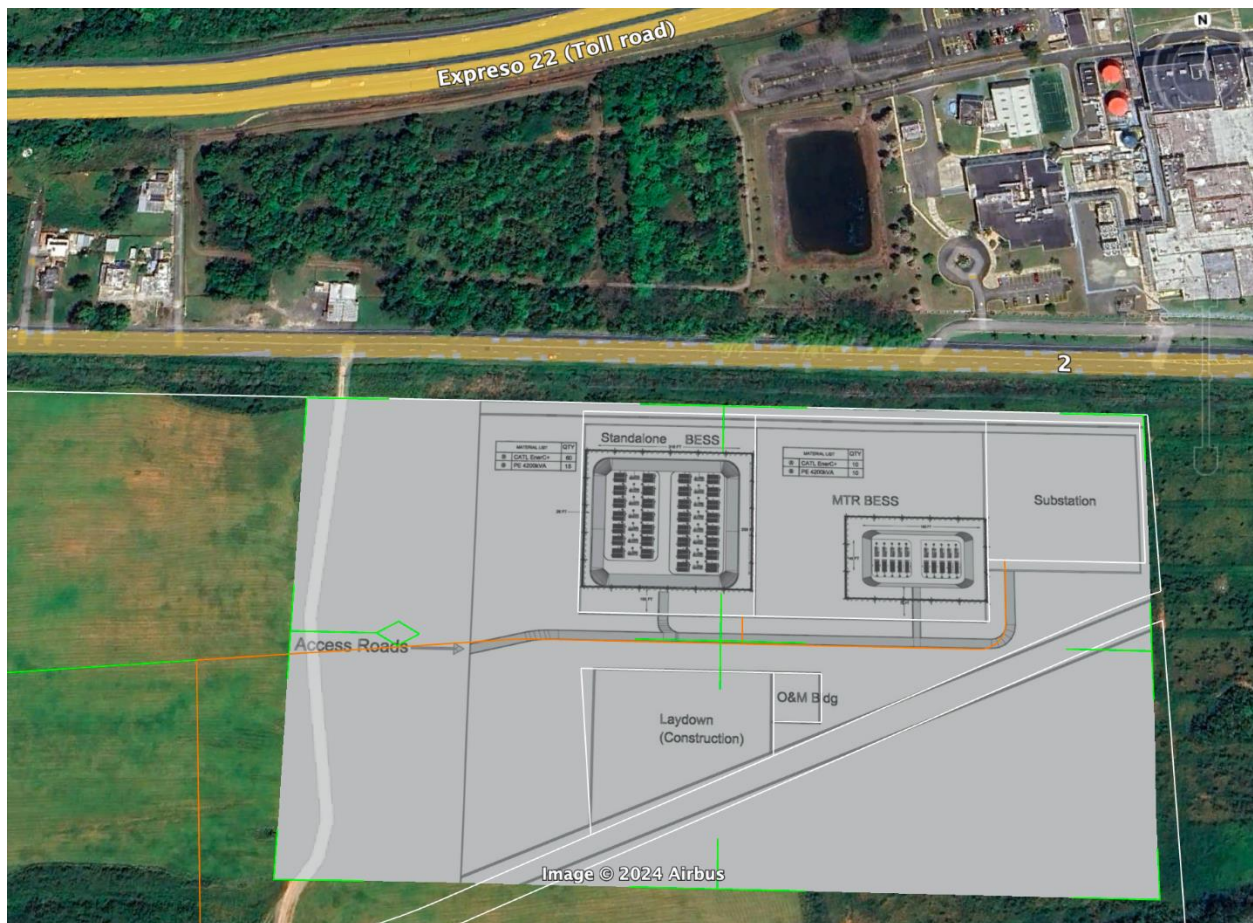


Figure 1 Project Area and Concept Location