

Appendix C-1 Site Description

The Barceloneta Storage LLC (the “Project”) is to be constructed on the north side of the island of Puerto Rico just south of county road 2 and directly to the west of the smaller MTR energy storage system (Pattern Barceloneta Solar LLC) as shown below in *Figure 1*.

Facility Descriptions

The Project’s BESS is rated at 50 MW / 200 MWh (full power discharge at the POI). The POI refers to the meter located on the primary side of the 115 kV GSU Transformer inside the PREPA Barceloneta substation as shown in the SLD in Exhibit B-2 Single Line Diagram. The planned distance from the Project to the substation is approximately 0.14 miles.

Project Site

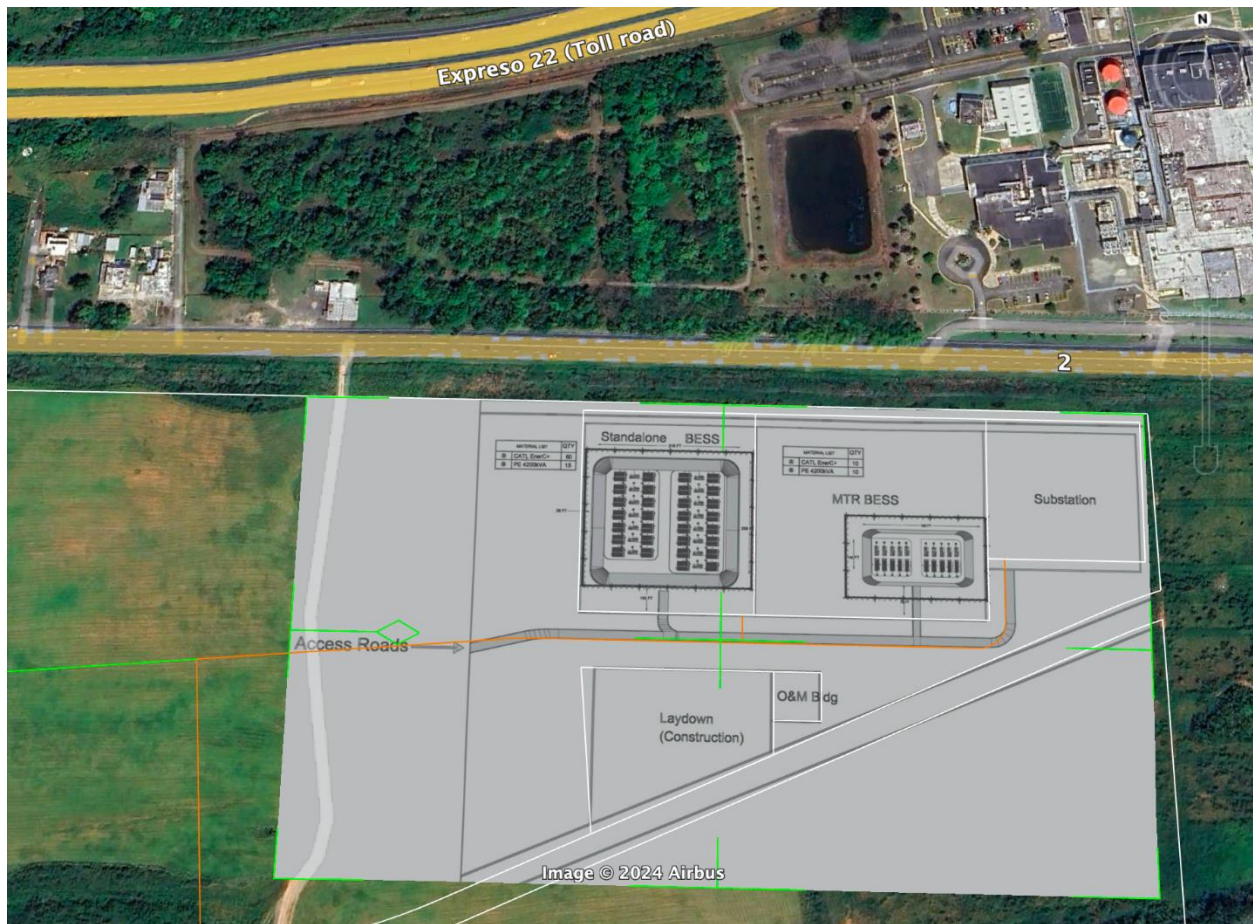


Figure 1 Project Area and Concept Location